

PHONE: 215.463.2332

FAX: 215.334.4990

E-MAIL: MARCOMANUF@AOL.COM

INCH-POUND

A-A-59125/32

26 September 1997

SUPERSEDING

MIL-M-55164/32B

7 March 1990

### COMMERCIAL ITEM DESCRIPTION SHEET

### MARKER STRIPS, FOR CLASS 40TB TERMINAL BOARDS

The General Services Administration has authorized the use of this commercial item description (CID) as a replacement for Class 40TB of MIL-T-55164/32 for all federal agencies.

The requirements for acquiring the product described herein shall consist of this sheet and CID A-A-59125.

#### REQUIREMENTS:

Dimensions and configuration: see Figure 1.


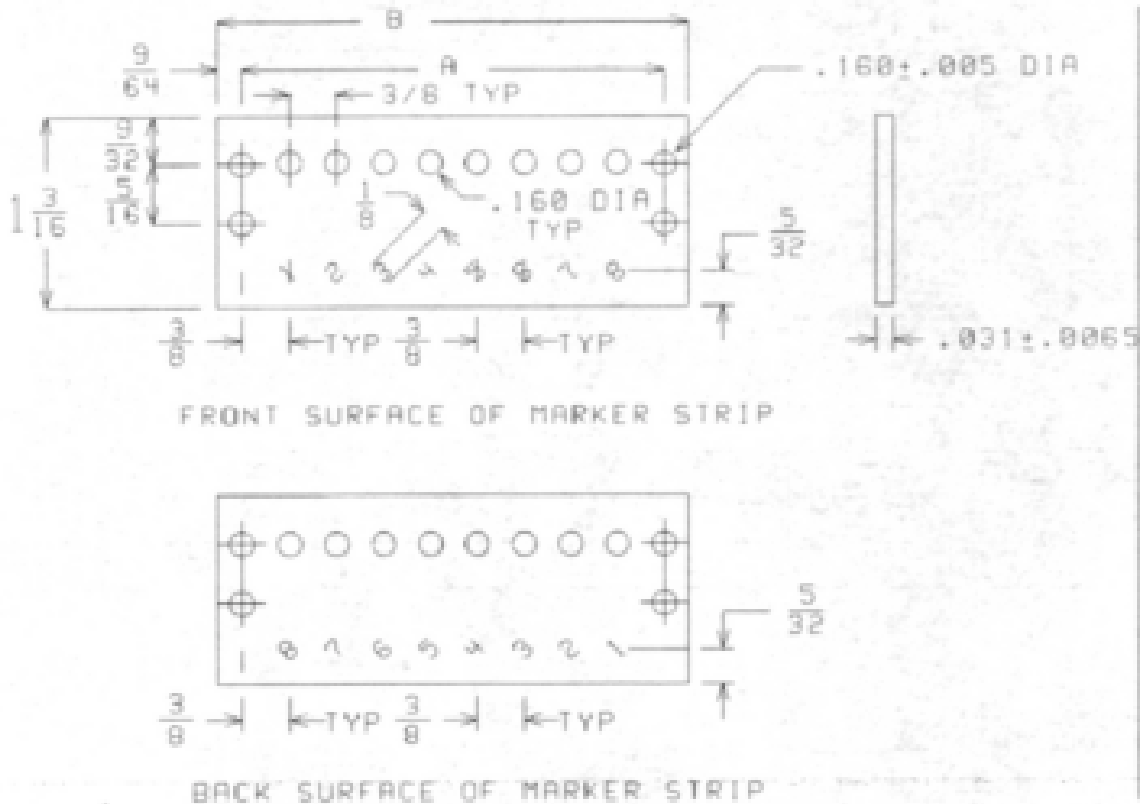


Figure 1. Terminal Board Marker Strip, Type MSA40TB8.

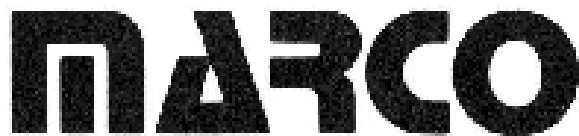

PHONE: 215.463.2332

FAX: 215.334.4990

E-MAIL: MARCOMANUF@AOL.COM

A-A-59125/32

Table I. Dimensions.

Marker Strip Type Designation	Dimensions	
	A	B
MS_40TB2	1.125	1.422
MS_40TB3	1.500	1.797
MS_40TB4	1.875	2.172
MS_40TB5	2.250	2.562
MS_40TB6	2.625	2.938
MS_40TB7	3.000	3.312
MS_40TB8	3.375	3.688
MS_40TB9	3.766	4.062
MS_40TB10	4.141	4.438
MS_40TB11	4.516	4.812
MS_40TB12	4.891	5.188
MS_40TB13	5.266	5.562
MS_40TB14	5.641	5.938
MS_40TB15	6.016	6.312
MS_40TB16	6.391	6.688
MS_40TB17	6.766	7.062
MS_40TB18	7.141	7.438
MS_40TB19	7.516	7.828
MS_40TB20	7.906	8.203
MS_40TB21	8.281	8.578
MS_40TB22	8.656	8.953
MS_40TB23	9.031	9.328
MS_40TB24	9.406	9.703
MS_40TB25	9.781	10.078
MS_40TB26	10.156	10.453
MS_40TB27	10.531	10.828
MS_40TB28	10.906	11.219
MS_40TB29	11.281	11.594
MS_40TB30	11.672	11.969
MS_40TB31	12.031	12.359

NOTES:

1. Dimensions are in inches.
2. Tolerances on terminal boards up to and including 6 inches in length:  
Dimension "A" + 0.031 to - 0.016  
Dimension "B" + 0.031 to - 0.062
3. Tolerances on terminal boards over 6 inches in length:  
Dimension "A" + 0.047 to - 0.031  
Dimension "B" + 0.047 to - 0.062
4. The drawing depicts only general design characteristics and is not intended to limit specific manufacturing processes.
5. Type of mount: bottom only.
6. Numbers shall be marked in contrasting colors to the marker strip.
7. The marker strip must align properly with the associated terminal board for mounting.
8. A single letter shall be inserted in the above type designation to specify the marking style (A, B or C).